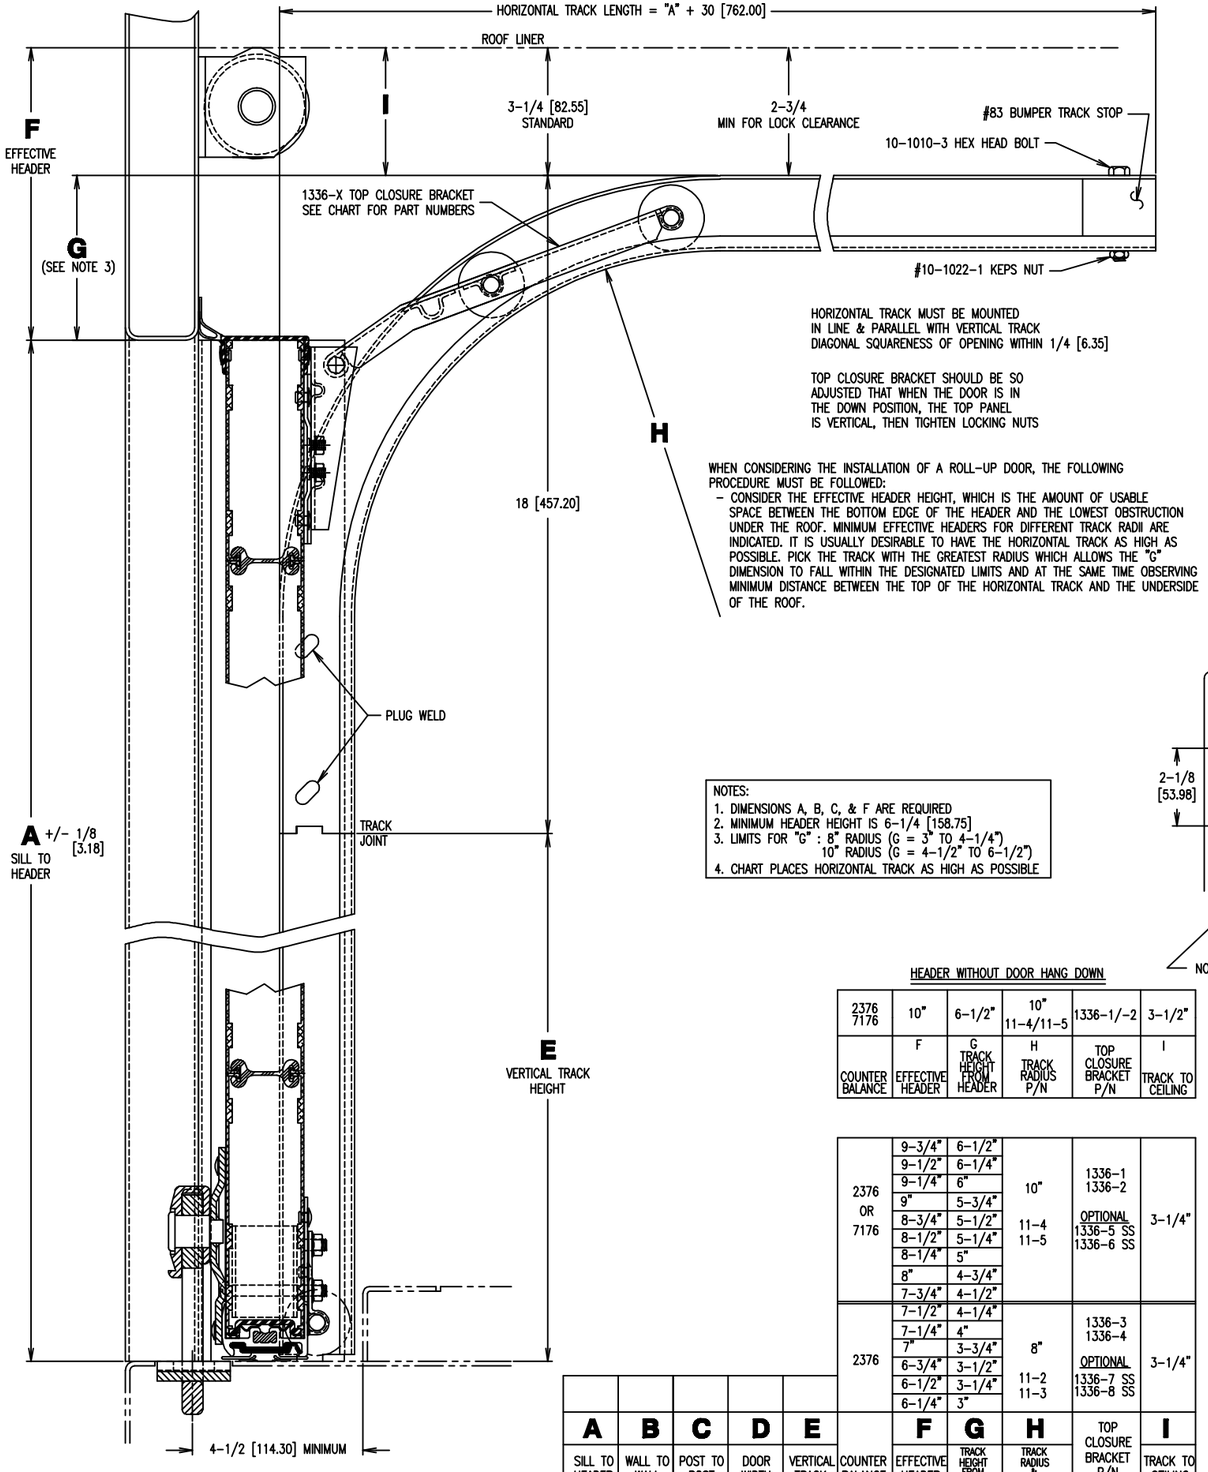


HORIZONTAL TRACK MUST BE MOUNTED IN LINE & PARALLEL WITH VERTICAL TRACK DIAGONAL SQUARENESS OF OPENING WITHIN 1/4 [6.35]

TOP CLOSURE BRACKET SHOULD BE SO ADJUSTED THAT WHEN THE DOOR IS IN THE DOWN POSITION, THE TOP PANEL IS VERTICAL, THEN TIGHTEN LOCKING NUTS

WHEN CONSIDERING THE INSTALLATION OF A ROLL-UP DOOR, THE FOLLOWING PROCEDURE MUST BE FOLLOWED:


- CONSIDER THE EFFECTIVE HEADER HEIGHT, WHICH IS THE AMOUNT OF USABLE SPACE BETWEEN THE BOTTOM EDGE OF THE HEADER AND THE LOWEST OBSTRUCTION UNDER THE ROOF. MINIMUM EFFECTIVE HEADERS FOR DIFFERENT TRACK RADII ARE INDICATED. IT IS USUALLY DESIRABLE TO HAVE THE HORIZONTAL TRACK AS HIGH AS POSSIBLE. PICK THE TRACK WITH THE GREATEST RADIUS WHICH ALLOWS THE "G" DIMENSION TO FALL WITHIN THE DESIGNATED LIMITS AND AT THE SAME TIME OBSERVING MINIMUM DISTANCE BETWEEN THE TOP OF THE HORIZONTAL TRACK AND THE UNDERSIDE OF THE ROOF.


NOTES:
1. DIMENSIONS A, B, C, & F ARE REQUIRED
2. MINIMUM HEADER HEIGHT IS 6-1/4 [158.75]
3. LIMITS FOR "G" : 8" RADIUS (G = 3" TO 4-1/4")
   10" RADIUS (G = 4-1/2" TO 6-1/2")
4. CHART PLACES HORIZONTAL TRACK AS HIGH AS POSSIBLE


HEADER WITHOUT DOOR HANG DOWN

COUNTER BALANCE	F EFFECTIVE HEADER	G TRACK HEIGHT FROM HEADER	H TRACK RADIUS P/N	TOP CLOSURE BRACKET P/N	I TRACK TO CEILING
2376 7176	10"	6-1/2"	10" 11-4/11-5	1336-1/-2	3-1/2"
2376 OR 7176	9-3/4"	6-1/2"	10"	1336-1 1336-2	3-1/4"
	9-1/2"	6-1/4"			
	9-1/4"	6"			
	9"	5-3/4"			
	8-3/4"	5-1/2"	11-4 11-5	OPTIONAL 1336-5 SS 1336-6 SS	
	8-1/2"	5-1/4"			
	8-1/4"	5"			
	8"	4-3/4"			
	7-3/4"	4-1/2"			
2376	7-1/2"	4-1/4"	8"	1336-3 1336-4	3-1/4"
	7-1/4"	4"			
	7"	3-3/4"			
	6-3/4"	3-1/2"	11-2 11-3	OPTIONAL 1336-7 SS 1336-8 SS	
	6-1/2"	3-1/4"			
	6-1/4"	3"			

A SILL TO HEADER	B WALL TO WALL	C POST TO POST	D DOOR WIDTH	E VERTICAL TRACK	COUNTER BALANCE	F EFFECTIVE HEADER	G TRACK HEIGHT FROM HEADER	H TRACK RADIUS & P/N	TOP CLOSURE BRACKET P/N	I TRACK TO CEILING

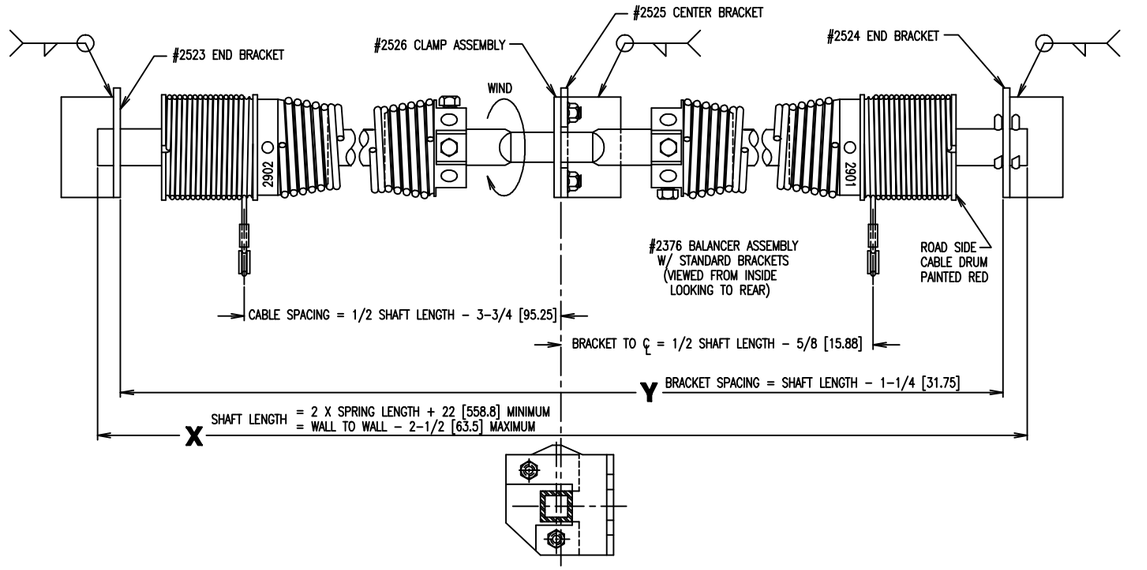

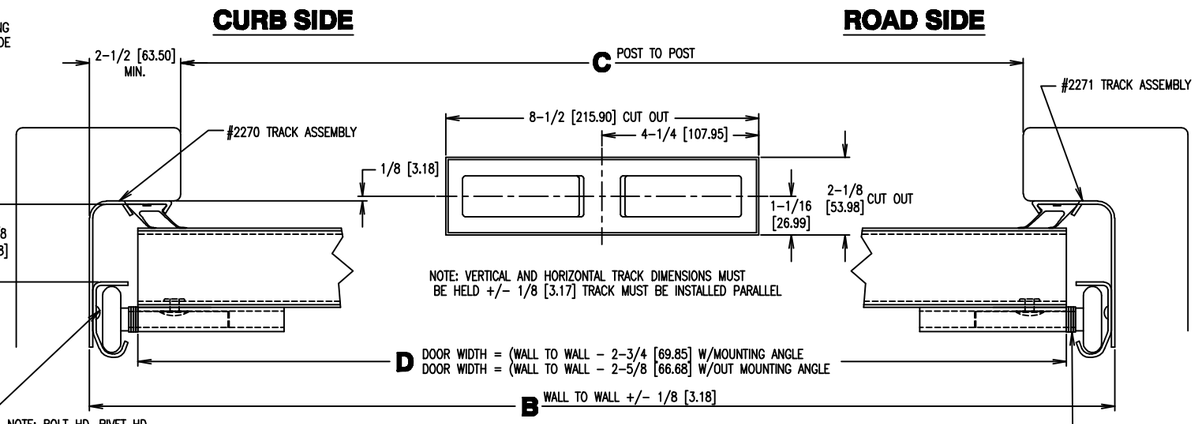

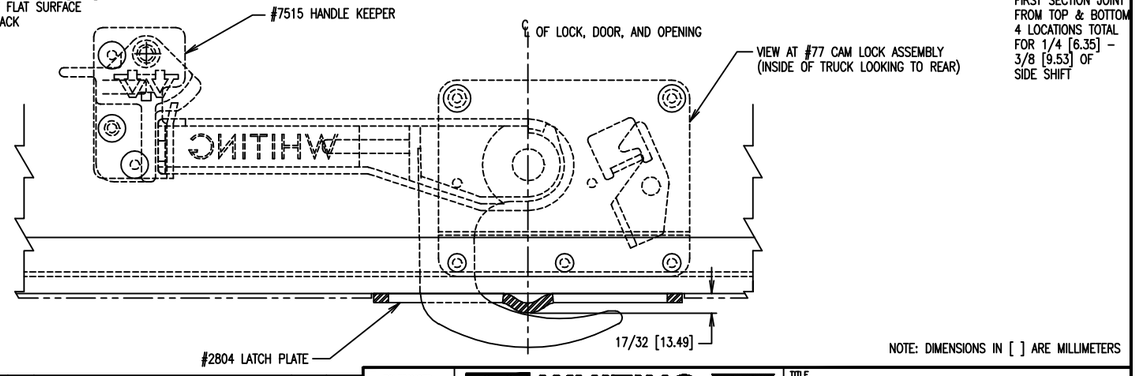

NOTE: DIMENSIONS IN [ ] ARE MILLIMETERS

12/2/09	T	ADDED MINIMUM CLEARANCE	MJS	GSB
8/12/09	S	ADDED CHART FOR NO HANG DOWN	MJS	GSB
6/13/08	R	REVISED PRINT, ADDED CHART	MJS	GSB
7/5/07	Q	REVISED PRINT, ADDED CHART	MJS	GSB
DATE	SYM	DESCRIPTION OF CHANGE	AUTH	DR

REVISIONS

TOLERANCES UNLESS OTHERWISE SPECIFIED ARE:
DECIMAL ±.010
FRACTION ±1/16
ANGLES ±1/2°
DO NOT SCALE DRAWING

WHITING DOOR MANUFACTURING CORP.
SEA-LOK DOORS MET-L-WOOD
GENERAL OFFICE: 113 CEDAR ST. AKRON, NY. 14001
"DEVELOPOR OF THE FIRST PRACTICAL ROLL-UP DOOR IN 1953"

TITLE: STANDARD INSTALLATION 2-1/8" COLDSAVER DOOR

DRAWN BY	DATE	CHECKED
METZ	6/18/79	
APPROVED BY	DATE	TERRITORY

SCALE	DWG. NO.	REV.
1/2"=1"	D-1946	T